



**Technický a zkušební ústav
stavební Praha, s.p.**
Prosecká 811/76a
190 00 Prague
Czech Republic
T: +420 286 019 400
W: www.tzus.cz



European Technical Assessment

ETA 20/0316
of 30/11/2020

General Part

Technical Assessment Body issuing the European Technical Assessment
Technický a zkušební ústav stavební Praha, s.p.

Trade name of the construction product	ALFIRSTE Drywall screw, ALFIRSTE Countersunk head timber screw, ALFIRSTE Wafer head timber screw
Product family to which the construction product belongs	Product area code: 13 Screws for use in timber constructions
Manufacturer	YUYAO ALFIRSTE HARDWARE CO., LTD. Huiqiao Rd 1121, Langxia Street 315400 YUYAO, China
Manufacturing plant	YUYAO ALFIRSTE HARDWARE CO., LTD. Huiqiao Rd 1121, Langxia Street 315400 YUYAO, China
This European Technical Assessment contains	24 pages including 3 Annexes, which form an integral part of this European Technical Assessment
This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of	EAD 130118-01-0603 Screws and threaded rods for use in timber constructions

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

1 Technical description of the product

ALFIRSTE Drywall screw, ALFIRSTE Countersunk head timber screw and ALFIRSTE Wafer head timber screw are made from carbon steel C1022/C10B21. Surface of the screws is covered by zinc or phosphate. Type of head is bugle, countersunk or wafer. The screws are with full thread or partial thread. All screws fulfill the requirement for a minimum bending angle of $\alpha = (45/d^{0.7} + 20)$. The screws are used for connections in load bearing timber structures between wood-based members.

1.1 Shape and dimensions

The outer thread diameter is not less than 3.5 mm and not greater than 10.0 mm. The overall length of the screws is ranging from 13 mm to 360 mm. Further dimensions are shown in Annex 1.

The ratio of inner thread diameter to outer thread diameter d_1/d ranges for all tested screws from 0.53 to 0.66.

The screws are threaded over a minimum length $l_g \geq 4 \cdot d$.

2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

The screws are intended to be used for connecting wood-based members where requirements for mechanical resistance and stability and safety in use shall be fulfilled. The screws are used for connections in load bearing timber structures between wood-based members:

- Solid timber (softwood) of strength classes C14 - C 40 according to EN 338¹ / EN 14081-1²
- Glued laminated timber (softwood) of at least strength class GL24c/GL24h according to EN 14080³
- Laminated veneer lumber LVL according to EN 14374⁴, arrangement of the screws only perpendicular to the plane of the veneers
- Glued laminated solid timber according to EN 14080³
- Cross laminated timber according to European Technical Assessments or national provisions that apply at the installation site

The screws may be used for connecting the following wood-based panels to the timber members mentioned above:

- Plywood according to EN 636+A1⁵ and EN 13986+A1⁶
- Oriented Strand Board, OSB according to EN 300⁷ and EN 13986+A1⁶
- Particleboard according to EN 312⁸ and EN 13986+A1⁶
- Fibreboards according to EN 622-2⁹, EN 622-3¹⁰ and EN 13986+A1⁶

¹ EN 338 Timber structures - Strength classes

² EN 14081-1 Timber structures - Strength graded structural timber with rectangular cross section - Part 1: General requirements

³ EN 14080 Timber structures - Glued laminated timber and glued solid timber - Requirements

⁴ EN 14374 Timber structures - Structural laminated veneer lumber - Requirements

⁵ EN 636 Plywood - Specification

⁶ EN 13986 Wood-based panels for use in construction - Characteristics, evaluation of conformity and marking

⁷ EN 300 Oriented strand boards (OSB) - Definition, classification and specifications

⁸ EN 312 Particleboards - Specifications

⁹ EN 622-2 Fibreboards - Specifications - Part 2: Requirements for hardboards

- Cement-bonded particle boards according to national provisions that apply at the building site
- Solid-wood panels according to national provisions that apply at the building site

Wood-based panels shall only be arranged on the side of the screw head.

According to EN 1995-1-1¹¹ the screws made from special stainless or carbon steel with $d > 4$ mm may be used in timber structures subject to climate conditions defined by service classes 1 and 2. According to EN 1995-1-1 the screws made from special stainless or carbon steel with $d \leq 4$ mm may be used in timber structures subject to climate conditions defined by service class 1. Regarding environmental conditions national provisions shall apply at the building site.

Corrosive categories according to EN ISO 12944-2 shall be taken into account.

The use of the screws shall be limited to static and quasi/static actions.

The provisions made in this European Technical Assessment are based on an assumed minimum working life of 50 years, provided that the screws are subject to appropriate use and maintenance.

The indications given as to the working life cannot be interpreted as a guarantee given by the producer or Technical Assessment Body but are regarded only as a mean for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

The assessment of the fitness for use of the ALFIRSTE Drywall screw, ALFIRSTE Countersunk head timber screw and ALFIRSTE Wafer head timber screw according to the basic work requirements (BWR) were carried out in compliance with EAD 130118-01-0603.

The European Technical Assessment is issued for the screws on the basis of agreed data and information, deposited at Technický a zkušební ústav stavební Praha, s.p., which identifies screws that has been assessed and judged. Changes to the screws or production process which could result in this deposited data and information being incorrect should be notified to Technický a zkušební ústav stavební Praha, s.p. before the changes are introduced. Technický a zkušební ústav stavební Praha, s.p. will decide whether or not such changes affect the ETA and consequently the validity of the CE marking on the basis of the ETA and if so whether further assessment or alternations to the ETA shall be necessary.

Table 1 Essential characteristics of the product

	Essential characteristic	Performance
3.1 BWR 1: Mechanical resistance and stability		
3.1.1	Dimensions	See Annex 1 and Annex 2
3.1.2	Characteristic yield moment	See Annex 2
3.1.3	Characteristic withdrawal parameter	See Annex 2
3.1.4	Characteristic head pull-through parameter	See Annex 2
3.1.5	Characteristic tensile strength	See Annex 2
3.1.6	Characteristic yield strength	See Annex 2
3.1.7	Characteristic torsional strength	See Annex 2
3.1.8	Insertion moment	See Annex 2
3.1.9	Bending angle	See Annex 2
3.1.10	Durability against corrosion	The screws are covered by zinc or phosphate
3.1.11	Spacing, end and edge distances of the screws	Point 3.1.11

¹⁰ EN 622-3 Fibreboards - Specifications - Part 3: Requirements for medium boards

¹¹ EN 1995-1-1 Design of timber structures - Part 1-1: General - Common rules and rules for buildings

	Essential characteristic	Performance
	and minimum thickness of the wood-based material	No performance assessed
3.1.12	Slip modulus for mainly axially loaded screws	No performance assessed
3.2 BWR 2: Safety in case of fire		
3.2.1	Reaction to fire	All screws are made from carbon steel C1022/C10B21 classified as Euroclass A in accordance with EC Decision 1996/603/EC, as amended by EC
BWR 4: Safety and accessibility in use		
Same as BWR 1		

3.1 Mechanical resistance and stability (BWR 1)

Annex 2 contains essential characteristics for all screws. The design and construction shall be carried out according to national provisions that apply at the installation site in line with the partial safety factor format, e.g. in accordance with EN 1995-1-1.

3.1.1 Dimensions

The dimensions have been measured according to provisions in EN 14592+A1. The dimensions are stated in tables at Annex 1 and measured values in tables at Annex 2.

3.1.2 Characteristic yield moment

The characteristic yield moment $M_{y,k}$ has been determined by tests according to EN 409. The test results are stated in tables at Annex 2.

3.1.3 Characteristic withdrawal parameter

The characteristic withdrawal parameters $f_{ax,0,k}$ and $f_{ax,90,k}$ have been determined by tests according to EN 1382. Density of used timber is mentioned in tables at Annex 2. The test results are stated in tables at Annex 2.

For angles α between screw axis and grain direction $15^\circ \leq \alpha < 45^\circ$ the characteristic withdrawal capacity $F_{ax,\alpha,Rk}$ shall be determined according to equation:

$$F_{ax,\alpha,Rk} = k_{ax} \cdot f_{ax,90,k} \cdot d \cdot l_{ef} \cdot (\rho_k/350)^{0,8}$$

where

k_{ax} factor to consider the influence of the angle between screw axis and grain direction and the long term behaviour

$$k_{ax} = 0,3 + (0,7 \cdot \alpha) / 45^\circ$$

$f_{ax,90,k}$ short-term characteristic withdrawal parameter for an angle α between screw axis and grain direction of 90° in N/mm^2

d outer thread diameter of the screw in mm

l_{ef} penetration length of the threaded part of the screw in the timber member in mm

ρ_k characteristic density of the wood-based member in kg/m^3

For angle α between screw axis and grain direction $0^\circ \leq \alpha < 15^\circ$ the following requirements were fulfilled and relevant equations can be used:

1. $f_{ax,0,k} / f_{ax,90,k} \geq 0.6$

2. The penetration length of the screws in the timber member shall be

$$l_{pen,req} = \min \left\{ \begin{array}{l} 4 \cdot d \\ \sin \alpha \\ 20 \cdot d \end{array} \right.$$

3. At least four screws shall be used in a connection with screws inserted in the timber member with an angle between screw axis and grain direction of less than 15°.

3.1.4 Characteristic head pull-through parameter

The characteristic head pull-through parameter $f_{head,k}$ has been determined by tests according to EN 1383. Density of used timber is mentioned in tables at Annex 2. The test results are stated in tables at Annex 2.

3.1.5 Characteristic tensile strength

The characteristic tensile strength $f_{tens,k}$ has been determined by tests according to EN 1383. The test results are stated in tables at Annex 2.

3.1.6 Characteristic yield strength

The characteristic yield strength has been determined by tests according to EN 1383. The test results are stated in tables at Annex 2.

3.1.7 Characteristic torsional strength

The characteristic torsional strength $f_{tor,k}$ has been determined by tests according to EN ISO 10666. The test results are stated in tables at Annex 2.

3.1.8 Insertion moment

The characteristic insertion moment $R_{tor,k}$ has been determined by tests according to EN 15737. The characteristic torsional ratio $f_{tor,k}/R_{tor,k} \geq 1.5$ has been fulfilled for all types of screws. The test results are stated in tables at Annex 2.

3.1.9 Bending angle

The bending angle α has been determined for each diameter of the screw. The test results are stated in tables at Annex 2. All screws fulfill the requirement for a minimum bending angle of $\alpha = (45/d^{0.7} + 20)$.

3.1.10 Durability against corrosion

The screws are made from carbon steel with corrosion protection layer. Surface of the screws is covered by zinc or phosphate.

3.1.11 Spacing, end and edge distances of the screws and minimum thickness of the wood-based material

No performance assessed.

Laterally loaded screws

For chipboard screws the minimum spacing, end and edge distances are given in EN 1995-1-1, clause 8.7.1.

Axially loaded screws

For chipboard screws the minimum spacing, end and edge distances are given in EN 1995-1-1, clause 8.7.2 and Table 8.6.

3.1.12 Slip modulus for mainly axially loaded screws

No performance assessed.

3.2 Safety in case of fire (BWR 2)

3.2.1 Reaction to fire

All screws are made from carbon steel C1022/C10B21 classified as Euroclass A in accordance with EC Decision 1996/603/EC, as amended by EC.

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

According to the Decision 1997/0176/EC¹², of the European Commission the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011 and Commission delegated Regulation (EU) No 568/2014) given in the following table applies:

Product(s)	Intended use(s)	Level(s) or class(es)	Attestation of conformity system(s)
Fasteners for structural timber products	Structural timber products		3

¹² 1997/0176/EC - European Commission decision of 17/2/1997, published in the Official Journal of the European Communities No L 73/19

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at the Technický a zkušební ústav stavební Praha, s.p.

Issued in Prague on 30/11/2020



By

Mária Schaan
Head of the TAB




Annexes:

- Annex 1 Dimensions and tolerances of ALFIRSTE Drywall screw, ALFIRSTE Countersunk head timber screw and ALFIRSTE Wafer head timber screw
- Annex 2 Essential characteristics of ALFIRSTE Drywall screw, ALFIRSTE Countersunk head timber screw and ALFIRSTE Wafer head timber screw
- Annex 3 Reference documents

Annex 1 Dimensions and tolerances of ALFIRSTE Drywall screw, ALFIRSTE Countersunk head timber screw and ALFIRSTE Wafer head timber screw

ALFIRSTE Drywall screw

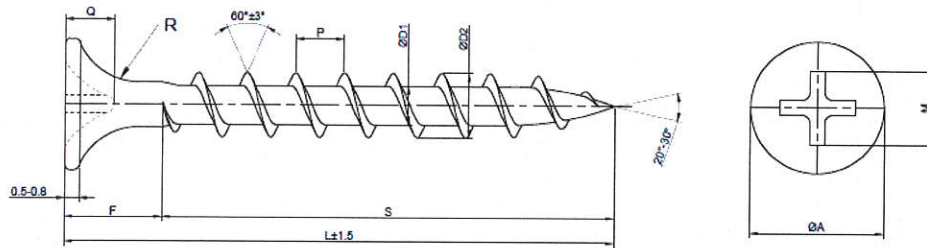


SIZE	A	F	D2	D	P	Q	M	R	DRIVE
3.5	7.90-8.50	4.50-7.00	3.50-3.90	2.05-2.35	2.70-2.80	2.35-2.93	4.50-5.10	4.50-5.00	PH2
4.0	7.90-8.50	4.50-7.00	3.80-4.20	2.20-2.50	2.70-2.80	2.35-2.93	4.50-5.10	4.50-5.00	PH2
4.8	8.50-9.10	4.50-7.00	4.90-5.35	3.05-3.35	3.10-3.20	2.50-3.18	4.50-5.10	4.50-5.00	PH2

3.5	4.0	4.8
$L \pm 1.5$		
13	16	90
16	20	100
19	25	110
25	28	120
32	30	130
35	40	140
41	56	152
45	60	
51	65	
55	70	
60	75	
65	80	

SURFACE HARDNESS: 560-653HV	CORE HRADNESS: 289-449
MATERIAL: C1022, SURFACE TREATMENT: PHOSPHATED	

ALFIRSTE Countersunk head timber screw

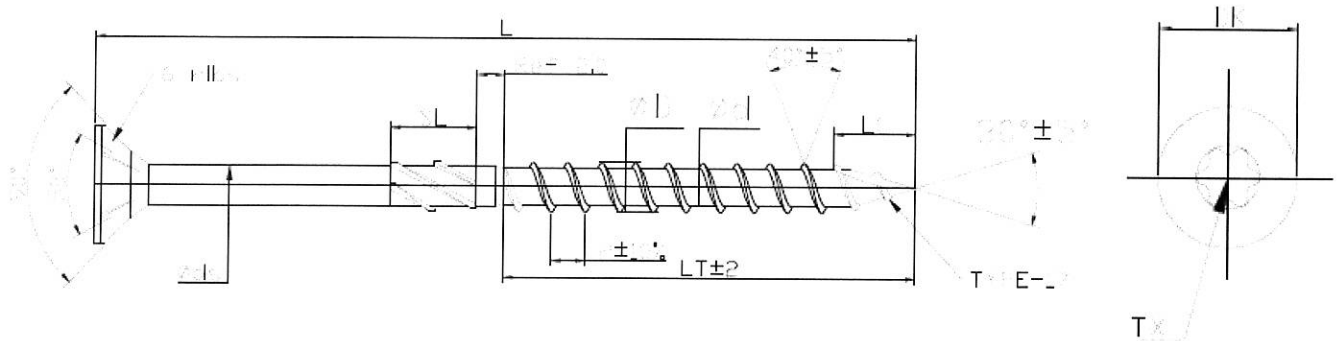

3,5		4,0		4,5		5,0		6,0		8,0		10,0	
L	LT	L	LT	L	LT	L	LT	L	LT	L	LT	L	LT
16	FULLY	16	FULLY	25	FULLY	25	FULLY	40	25	80	50	80	50
20	FULLY	20	FULLY	30	FULLY	30	FULLY	50	25	90	50	90	50
25	FULLY	25	FULLY	35	25	35	25	60	35	100	50	100	50
30	15	30	16	40	25	40	25	70	35	110	50	110	50
35	15	35	16	45	25	45	25	80	50	120	80	120	80
40	25	40	25	50	25	50	25	90	50	140	80	140	80
45	25	45	25	60	35	60	35	100	50	160	80	160	80
50	25	50	25	70	35	70	35	110	50	180	80	180	80
-	-	55	35	80	35	80	50	120	70	200	80	200	80
-	-	60	35	-	-	90	50	130	70	220	80	220	80
-	-	70	35	-	-	100	50	140	70	240	80	240	80

L<25 b=1.25;25<L<80 b=1.75;L>80 b=2.5 L<25,NO SERRATION	120	50	130-300	70	260	80	260	80
	-	-	-	-	280	80	280	80
	-	-	-	-	300	80	300	80
	-	-	-	-	320	80	320	80
	-	-	-	-	340	80	340	80
	-	-	-	-	360	80	360	80

NOTE:

1.MATERIAL:C10B21

2.SURFACE HARDNESS:450HV-750 HV 0.3


3.CORE HARDNESS:300HV-450 HV 0.3

4.BENDING ANGLE:Min.45°

5.Surface treatment: Zinc plated; Thickness: 3-5µm

size	DK	TX	Ds	SL	D	d	P	Lc
M3.5	6.6-7.0	T15	2.33-2.57	ref5	3.3-3.6	1.9-2.2	2.2	ref6
M4.0	7.5-8.0	T20	2.6-2.84	ref5	3.8-4.1	2.2-2.5	2.6	ref8
M4.5	8.5-9.0	T25	3.03-3.27	ref6	4.2-4.6	2.6-3.0	2.8	ref8
M5.0	9.5-10.0	T25	3.35-3.59	ref8	4.7-5.1	2.7-3.1	3.2	ref10
M6.0	11.5-12.0	T30	4.18-4.42	ref12	5.8-6.2	3.6-4.0	4.5	ref10
M8.0	14.3-15.2	T40	5.66-5.9	ref12	7.8-8.3	5.1-5.5	5.5	ref12
M10.0	17.4-18.2	T40	6.88-7.12	ref12	9.7-10.3	6.0-6.5	6.6	ref12

ALFIRSTE Wafer head timber screw

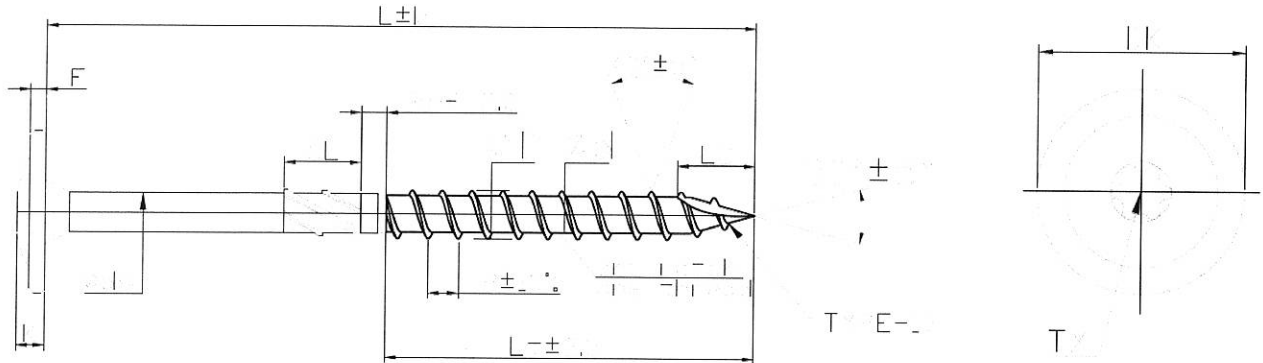

3.5		4.0		4.5		5.0		6.0		8.0		10.0	
L	LT	L	LT	L	LT	L	LT	L	LT	L	LT	L	LT
16	FULLY	16	FULLY	25	FULLY	25	FULLY	40	25	80	50	80	50
20	FULLY	20	FULLY	30	FULLY	30	FULLY	50	25	90	50	90	50
25	FULLY	25	FULLY	35	25	35	25	60	35	100	50	100	50
30	15	30	16	40	25	40	25	70	35	110	50	110	50
35	15	35	16	45	25	45	25	80	50	120	80	120	80
40	25	40	25	50	25	50	25	90	50	140	80	140	80
45	25	45	25	60	35	60	35	100	50	160	80	160	80
50	25	50	25	70	35	70	35	110	50	180	80	180	80
-	-	55	35	80	35	80	50	120	70	200	80	200	80
-	-	60	35	-	-	90	50	130	70	220	80	220	80
-	-	70	35	-	-	100	50	140	70	240	80	240	80
L<25 b=1.25;25<L<40 b=1.75;L>80 b=2.5 L<25,NO SERRATION						120	50	150-160	70	260	80	260	80
						-	-			280	80	280	80
						-	-	-	-	300	80	300	80
						-	-	-	-	320	80	320	80
						-	-	-	-	340	80	340	80
-	-	-	-	360	80	360	80						

NOTE:

- 1.MATERIAL:C10B21
- 2.SURFACE HARDNESS:450HV-750 HV 0.3
- 3.CORE HARDNESS:300HV-450 HV 0.3
- 4.BENDING ANGLE:Min.45°
- 5.Surface treatment: Zinc plated; Thickness: 3-5µm

SIZE	DK	K	F	TX	ds	SL	D	d	p	Lc
M3.5	8.2-8.8	1.8-2.0	ref0.9	T15	2.33-2.57	ref5	3.3-3.6	1.9-2.2	2	ref6
M4.0	9.0-9.8	2.0-2.25	ref1.0	T20	2.6-2.84	ref5	3.8-4.1	2.2-2.5	2.6	ref8
M4.5	10.2-11.0	2.2-2.45	ref1.3	T20	3.03-3.27	ref6	4.2-4.6	2.6-3.0	2.8	ref8
M5.0	11.2-12.0	2.35-2.65	ref1.5	T20	3.3-3.59	ref8	4.7-5.1	2.7-3.1	3.2	ref10
M6.0	12.2-13.8	2.7-3.05	ref1.6	T30	4.18-4.42	ref12	5.8-6.2	3.6-4.0	4.5	ref10
M8.0	20.0-22.0	3.4-3.75	ref2.0	T40	5.66-5.9	ref12	7.8-8.3	5.1-5.5	5.5	ref12
M10	23.0-26.0	3.8-4.2	ref2.2	T40	6.88-7.12	ref12	9.7-10.3	6.0-6.5	6.6	ref12

Annex 2 Essential characteristics of ALFIRSTE Drywall screw, ALFIRSTE Countersunk head timber screw and ALFIRSTE Wafer head timber screw

3.1 Mechanical resistance and stability (BWR 1)

Table 2 Timber screw diameter M3.5, csk head, torx recess, partial thread, zinc plated

3.1.1	Average value of geometry	
	\varnothing [mm]	Partial thread
d (mm)	3.5	3.55
d_1 (mm)	3.5	2.14
d_h (mm)	3.5	6.70
d_s (mm)	3.5	2.43
p pitch thread (mm)	3.5	2.23
l_g (mm)	3.5	29.42
l (mm)	3.5	49.18
3.1.2	Characteristic yield moment	
$M_{y,k}$ (Nmm)	\varnothing [mm]	
	3.5	1954
3.1.3	Characteristic withdrawal parameter	
	\varnothing [mm]	
$f_{ax,90,k}$ (N/mm ²)	3.5	17.77 (*)
$f_{ax,0,k}$ (N/mm ²)	3.5	14.16 (*)
3.1.4	Characteristic head pull-through parameter	
$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
	3.5	25.87(*)
3.1.5	Characteristic tensile capacity	
$f_{tens,k}$ (kN)	\varnothing [mm]	
	3.5	3.93
3.1.6	Characteristic yield strength	
	\varnothing [mm]	
R_m (MPa)	3.5	1213.9
$R_{p0.2}$ (MPa)	3.5	1198.3
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)	
3.1.8		
$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	
	3.5	2.00/0.95=2.11
3.1.9	Bending angle	
Bending angle (°)	\varnothing [mm]	
	3.5	41°
3.1.10	Average value of durability against corrosion (protective layer thickness)	
Protective layer thickness (μm)	\varnothing [mm]	
	3.5	25.0

* density of timber 350 kg/m³

Table 3 Timber screw diameter M4.0, csk head, torx recess, partial thread, zinc plated

3.1.1	Average value of geometry	
	\varnothing [mm]	Partial thread
d (mm)	4.0	4.04
d_1 (mm)	4.0	2.40
d_h (mm)	4.0	7.93
d_s (mm)	4.0	2.77
p pitch thread (mm)	4.0	2.60
l_\varnothing (mm)	4.0	35.95
l (mm)	4.0	68.78
3.1.2	Characteristic yield moment	
$M_{y,k}$ (Nmm)	\varnothing [mm]	
	4.0	3003
3.1.3	Characteristic withdrawal parameter	
	\varnothing [mm]	
$f_{ax,90,k}$ (N/mm ²)	4.0	17.58 (*)
$f_{ax,0,k}$ (N/mm ²)	4.0	13.33 (*)
3.1.4	Characteristic head pull-through parameter	
$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
	4.0	25.46(*)
3.1.5	Characteristic tensile capacity	
$f_{tens,k}$ (kN)	\varnothing [mm]	
	4.0	5.17
3.1.6	Characteristic yield strength	
	\varnothing [mm]	
R_m (MPa)	4.0	1265.1
$R_{p0.2}$ (MPa)	4.0	1254.6
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)	
3.1.8		
$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	
	4.0	3.02/1.24=2.43
3.1.9	Bending angle	
Bending angle (°)	\varnothing [mm]	
	4.0	62°
3.1.10	Average value of durability against corrosion (protective layer thickness)	
Protective layer thickness (μ m)	\varnothing [mm]	
	4.0	27.1

* density of timber 350 kg/m³

Table 4 Timber screw diameter M4.5, csk head, torx recess, partial thread, zinc plated

3.1.1	Average value of geometry	
	\varnothing [mm]	Partial thread
d (mm)	4.5	4.51
d_1 (mm)	4.5	2.81
d_h (mm)	4.5	8.77
d_s (mm)	4.5	3.14
p pitch thread (mm)	4.5	2.77
l_g (mm)	4.5	50.20
l (mm)	4.5	79.12
3.1.2	Characteristic yield moment	
$M_{y,k}$ (Nmm)	\varnothing [mm]	
	4.5	5026
3.1.3	Characteristic withdrawal parameter	
	\varnothing [mm]	
$f_{ax,90,k}$ (N/mm ²)	4.5	16.29 (*)
$f_{ax,0,k}$ (N/mm ²)	4.5	12.84 (*)
3.1.4	Characteristic head pull-through parameter	
$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
	4.5	24.39(*)
3.1.5	Characteristic tensile capacity	
$f_{tens,k}$ (kN)	\varnothing [mm]	
	4.5	7.54
3.1.6	Characteristic yield strength	
	\varnothing [mm]	
R_m (MPa)	4.5	1349.6
$R_{p0.2}$ (MPa)	4.5	1343.0
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)	
3.1.8		
$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	
	4.5	4.99/2.03=2.46
3.1.9	Bending angle	
$Bending\ angle$ (°)	\varnothing [mm]	
	4.5	39°
3.1.10	Average value of durability against corrosion (protective layer thickness)	
$Protective\ layer\ thickness$ (µm)	\varnothing [mm]	
	4.5	25.7

* density of timber 350 kg/m³

Table 5 Timber screw diameter M5.0, csk head, torx recess, partial thread, zinc plated

3.1.1	Average value of geometry	
	\varnothing [mm]	Partial thread
d (mm)	5.0	4.96
d_1 (mm)	5.0	3.08
d_h (mm)	5.0	9.84
d_s (mm)	5.0	3.46
p pitch thread (mm)	5.0	3.12
l_g (mm)	5.0	50.24
l (mm)	5.0	79.38
3.1.2	Characteristic yield moment	
$M_{y,k}$ (Nmm)	\varnothing [mm]	
	5.0	6389
3.1.3	Characteristic withdrawal parameter	
	\varnothing [mm]	
$f_{ax,90,k}$ (N/mm ²)	5.0	16.47 (*)
$f_{ax,0,k}$ (N/mm ²)	5.0	12.93 (*)
3.1.4	Characteristic head pull-through parameter	
$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
	5.0	23.09(*)
3.1.5	Characteristic tensile capacity	
$f_{tens,k}$ (kN)	\varnothing [mm]	
	5.0	8.79
3.1.6	Characteristic yield strength	
	\varnothing [mm]	
R_m (MPa)	5.0	1285.8
$R_{p0.2}$ (MPa)	5.0	1282.2
3.1.7 3.1.8	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)	
$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	
	5.0	6.14/2.70=2.27
3.1.9	Bending angle	
Bending angle (°)	\varnothing [mm]	
	5.0	40°
3.1.10	Average value of durability against corrosion (protective layer thickness)	
Protective layer thickness (μm)	\varnothing [mm]	
	5.0	23.3

* density of timber 350 kg/m³

Table 6 Timber screw diameter M6.0, csk head, torx recess, partial thread, zinc plated

3.1.1		Average value of geometry	
		\varnothing [mm]	Partial thread
d (mm)		6.0	6.00
d_1 (mm)		6.0	3.71
d_h (mm)		6.0	11.64
d_s (mm)		6.0	4.16
p pitch thread (mm)		6.0	4.40
l_g (mm)		6.0	59.89
l (mm)		6.0	99.86
3.1.2		Characteristic yield moment	
$M_{y,k}$ (Nmm)		\varnothing [mm]	
		6.0	9684
3.1.3		Characteristic withdrawal parameter	
		\varnothing [mm]	
$f_{ax,90,k}$ (N/mm ²)		6.0	15.00 (*)
$f_{ax,0,k}$ (N/mm ²)		6.0	12.59 (*)
3.1.4		Characteristic head pull-through parameter	
$f_{head,k}$ (N/mm ²)		\varnothing [mm]	
		6.0	22.73(*)
3.1.5		Characteristic tensile capacity	
$f_{tens,k}$ (kN)		\varnothing [mm]	
		6.0	12.27
3.1.6		Characteristic yield strength	
		\varnothing [mm]	
R_m (MPa)		6.0	1261.6
$R_{p0.2}$ (MPa)		6.0	1244.9
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)		
3.1.8	$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	
		6.0	10.81/4.51=2.40
3.1.9		Bending angle	
$Bending\ angle$ (°)		\varnothing [mm]	
		6.0	40°
3.1.10		Average value of durability against corrosion (protective layer thickness)	
$Protective\ layer\ thickness$ (μm)		\varnothing [mm]	
		6.0	23.3

* density of timber 350 kg/m³

Table 7 Timber screw diameter M6.0, wafer head, torx recess, partial thread, zinc plated

3.1.1		Average value of geometry		
		\varnothing [mm]	Partial thread	
d (mm)		6.0	6.04	
d_1 (mm)		6.0	3.93	
d_h (mm)		6.0	14.24	
d_s (mm)		6.0	4.23	
p pitch thread (mm)		6.0	4.27	
l_g (mm)		6.0	60.43	
l (mm)		6.0	97.94	
l (mm)		6.0	117.65	
3.1.2		Characteristic yield moment		
$M_{y,k}$ (Nmm)		\varnothing [mm]		
		6.0	8868	
3.1.3		Characteristic withdrawal parameter		
		\varnothing [mm]		
$f_{ax,90,k}$ (N/mm ²)		6.0	15.63 (*)	
$f_{ax,0,k}$ (N/mm ²)		6.0	12.86 (*)	
3.1.4		Characteristic head pull-through parameter		
$f_{head,k}$ (N/mm ²)		\varnothing [mm]		
		6.0	26.39(*)	
3.1.5		Characteristic tensile capacity		
$f_{tens,k}$ (kN)		\varnothing [mm]		
		6.0	13.38	
3.1.6		Characteristic yield strength		
		\varnothing [mm]		
R_m (MPa)		6.0	1224.6	
$R_{p0.2}$ (MPa)		6.0	1180.1	
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)			
3.1.8		\varnothing [mm]		
$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)		6.0	Screw 100 mm	Screw 120 mm
			11.81/4.34=2.72	11.81/4.73=2.50
3.1.9		Bending angle		
$Bending\ angle\ (^{\circ})$		\varnothing [mm]		
		6.0	49°	
3.1.10		Average value of durability against corrosion (protective layer thickness)		
$Protective\ layer\ thickness\ (\mu m)$		\varnothing [mm]		
		6.0	17.6	

* density of timber 350 kg/m³

Table 8 Timber screw diameter M8.0, csk head, torx recess, partial thread, zinc plated

3.1.1		Average value of geometry	
		\varnothing [mm]	Partial thread
	d (mm)	8.0	8.10
	d_1 (mm)	8.0	5.29
	d_h (mm)	8.0	14.64
	d_s (mm)	8.0	5.85
	p pitch thread (mm)	8.0	5.19
	l_g (mm)	8.0	81.15
	l (mm)	8.0	118.36
3.1.2		Characteristic yield moment	
	$M_{y,k}$ (Nmm)	\varnothing [mm]	
		8.0	23033
3.1.3		Characteristic withdrawal parameter	
		\varnothing [mm]	
	$f_{ax,90,k}$ (N/mm ²)	8.0	14.90 (*)
	$f_{ax,0,k}$ (N/mm ²)	8.0	12.01 (*)
3.1.4		Characteristic head pull-through parameter	
	$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
		8.0	24.27(*)
3.1.5		Characteristic tensile capacity	
	$f_{tens,k}$ (kN)	\varnothing [mm]	
		8.0	23.25
3.1.6		Characteristic yield strength	
		\varnothing [mm]	
	R_m (MPa)	8.0	1170.3
	$R_{p0.2}$ (MPa)	8.0	1055.8
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)		
3.1.8	$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	
		8.0	27.73/10.01=2.77
3.1.9		Bending angle	
	Bending angle (°)	\varnothing [mm]	
		8.0	50°
3.1.10		Average value of durability against corrosion (protective layer thickness)	
	Protective layer thickness (μm)	\varnothing [mm]	
		8.0	17.5

* density of timber 350 kg/m³

Table 9 Timber screw diameter M8.0, wafer head, torx recess, partial thread, zinc plated

3.1.1		Average value of geometry		
		\varnothing [mm]	Partial thread	
d (mm)		8.0	8.10	
d_1 (mm)		8.0	5.32	
d_h (mm)		8.0	20.66	
d_s (mm)		8.0	5.77	
p pitch thread (mm)		8.0	5.46	
l_q (mm)		8.0	81.56	
l (mm)		8.0	198,49	
l (mm)		8.0	119.60	
3.1.2		Characteristic yield moment		
$M_{y,k}$ (Nmm)		\varnothing [mm]	Thread section	Smooth section
		8.0	21718	31573
3.1.3		Characteristic withdrawal parameter		
		\varnothing [mm]		
$f_{ax,90,k}$ (N/mm ²)		8.0	15.16 (*)	
$f_{ax,0,k}$ (N/mm ²)		8.0	12.40 (*)	
3.1.4		Characteristic head pull-through parameter		
$f_{head,k}$ (N/mm ²)		\varnothing [mm]		
		8.0	26.28(*)	
3.1.5		Characteristic tensile capacity		
$f_{tens,k}$ (kN)		\varnothing [mm]		
		8.0	25.85	
3.1.6		Characteristic yield strength		
		\varnothing [mm]		
R_m (MPa)		8.0	1278.2	
$R_{p0.2}$ (MPa)		8.0	1239.3	
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)			
3.1.8	$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	Screw 120 mm	Screw 200 mm
		8.0	29.68/10.30=2.88	29.68/11.31=2.62
3.1.9		Bending angle		
$Bending\ angle\ (^{\circ})$		\varnothing [mm]		
		8.0	39°	
3.1.10		Average value of durability against corrosion (protective layer thickness)		
$Protective\ layer\ thickness\ (\mu m)$		\varnothing [mm]		
		8.0	18.2	

* density of timber 350 kg/m³

Table 10 Timber screw diameter M10.0, csk head, torx recess, partial thread, zinc plated

3.1.1 Average value of geometry		
	\varnothing [mm]	Partial thread
d (mm)	10.0	9.96
d_1 (mm)	10.0	6.33
d_h (mm)	10.0	17.99
d_s (mm)	10.0	7.02
p pitch thread (mm)	10.0	6.58
l_g (mm)	10.0	78.14
l (mm)	10.0	119.58
3.1.2 Characteristic yield moment		
$M_{y,k}$ (Nmm)	\varnothing [mm]	
	10.0	35783
3.1.3 Characteristic withdrawal parameter		
	\varnothing [mm]	
$f_{ax,90,k}$ (N/mm ²)	10.0	14.88 (*)
$f_{ax,0,k}$ (N/mm ²)	10.0	11.24 (*)
3.1.4 Characteristic head pull-through parameter		
$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
	10.0	23.07(*)
3.1.5 Characteristic tensile capacity		
$f_{tens,k}$ (kN)	\varnothing [mm]	
	10.0	30.32
3.1.6 Characteristic yield strength		
	\varnothing [mm]	
R_m (MPa)	10.0	1080.1
$R_{p0.2}$ (MPa)	10.0	833.0
3.1.7 3.1.8	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)	
$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	
	10.0	44.13/16.37=2.70
3.1.9 Bending angle		
Bending angle (°)	\varnothing [mm]	
	10.0	43°
3.1.10 Average value of durability against corrosion (protective layer thickness)		
Protective layer thickness (μ m)	\varnothing [mm]	
	10.0	14.4

* density of timber 350 kg/m³

Table 11 Timber screw diameter M10.0, wafer head, torx recess, partial thread, zinc plated

3.1.1	Average value of geometry		
	\varnothing [mm]	Partial thread	
d (mm)	10.0	9.95	
d_1 (mm)	10.0	6.37	
d_h (mm)	10.0	24.11	
d_s (mm)	10.0	6.89	
p pitch thread (mm)	10.0	6.59	
l_g (mm)	10.0	78.98	
l (mm)	10.0	198.70	
l (mm)	10.0	118.62	
3.1.2	Characteristic yield moment		
	$M_{y,k}$ (Nmm)	\varnothing [mm]	Thread section / Smooth section
		10.0	37209 / 53855
3.1.3	Characteristic withdrawal parameter		
		\varnothing [mm]	
	$f_{ax,90,k}$ (N/mm ²)	10.0	14.75 (*)
	$f_{ax,0,k}$ (N/mm ²)	10.0	10.25 (*)
3.1.4	Characteristic head pull-through parameter		
	$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
		10.0	24.05(*)
3.1.5	Characteristic tensile capacity		
	$f_{tens,k}$ (kN)	\varnothing [mm]	
		10.0	34.27
3.1.6	Characteristic yield strength		
		\varnothing [mm]	
	R_m (MPa)	10.0	1220.9
	$R_{p0.2}$ (MPa)	10.0	1076.2
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)		
3.1.8	$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	Screw 120 mm / Screw 200 mm
		10.0	46.93/15.51=3.03 / 46.93/16.42=2.86
3.1.9	Bending angle		
	Bending angle (°)	\varnothing [mm]	
		10.0	48°
3.1.10	Average value of durability against corrosion (protective layer thickness)		
	Protective layer thickness (µm)	\varnothing [mm]	
		10.0	14.6

* density of timber 350 kg/m³

Table 12 Drywall screw diameter M3.5, Phillips recess, full thread, black phosphate

3.1.1	Average value of geometry	
	\varnothing [mm]	Full thread
d (mm)	3.5	3.80
d_1 (mm)	3.5	2.21
d_h (mm)	3.5	8.13
p pitch thread (mm)	3.5	2.86
l_g (mm)	3.5	38.27
l (mm)	3.5	44.10
3.1.2	Characteristic yield moment	
$M_{y,k}$ (Nmm)	\varnothing [mm]	
	3.5	2072
3.1.3	Characteristic withdrawal parameter	
	\varnothing [mm]	
$f_{ax,90,k}$ (N/mm ²)	3.5	17.72 (*)
$f_{ax,0,k}$ (N/mm ²)	3.5	15.42 (*)
3.1.4	Characteristic head pull-through parameter	
$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
	3.5	23.22(*)
3.1.5	Characteristic tensile capacity	
$f_{tens,k}$ (kN)	\varnothing [mm]	
	3.5	4.62
3.1.6	Characteristic yield strength	
	\varnothing [mm]	
R_m (MPa)	3.5	1326.6
$R_{p0.2}$ (MPa)	3.5	1295.7
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)	
3.1.8		
$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	
	3.5	2.67/0.97=2,74
3.1.9	Bending angle	
Bending angle (°)	\varnothing [mm]	
	3.5	41°

* density of timber 350 kg/m³

Table 13 Drywall screw diameter M4.0, Phillips recess, partial thread, black phosphate

3.1.1	Average value of geometry	
	\varnothing [mm]	Partial thread
d (mm)	4.0	4.08
d_1 (mm)	4.0	2.23
d_h (mm)	4.0	8.21
d_s (mm)	4.0	2.64
p pitch thread (mm)	4.0	2.85
l_g (mm)	4.0	49.45
l (mm)	4.0	63.49
3.1.2	Characteristic yield moment	
$M_{y,k}$ (Nmm)	\varnothing [mm]	
	4.0	2214
3.1.3	Characteristic withdrawal parameter	
	\varnothing [mm]	
$f_{ax,90,k}$ (N/mm ²)	4.0	17.17 (*)
$f_{ax,0,k}$ (N/mm ²)	4.0	15.30 (*)
3.1.4	Characteristic head pull-through parameter	
$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
	4.0	22.99(*)
3.1.5	Characteristic tensile capacity	
$f_{tens,k}$ (kN)	\varnothing [mm]	
	4.0	4.44
3.1.6	Characteristic yield strength	
	\varnothing [mm]	
R_m (MPa)	4.0	1277.6
$R_{p0.2}$ (MPa)	4.0	1254.5
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)	
3.1.8		
$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	\varnothing [mm]	
	4.0	2.93/1.19=2.46
3.1.9	Bending angle	
Bending angle (°)	\varnothing [mm]	
	4.0	41°

* density of timber 350 kg/m³

Table 14 Drywall screw diameter M4.8, Phillips recess, partial thread, black phosphate

3.1.1		Average value of geometry	
		\varnothing [mm]	Partial thread
d (mm)		4.8	5.14
d_1 (mm)		4.8	2.72
d_h (mm)		4.8	8.62
d_s (mm)		4.8	3.21
p pitch thread (mm)		4.8	3.23
l_g (mm)		4.8	58.82
l (mm)		4.8	99.23
3.1.2		Characteristic yield moment	
	$M_{y,k}$ (Nmm)	\varnothing [mm]	
		4.8	3753
3.1.3		Characteristic withdrawal parameter	
		\varnothing [mm]	
	$f_{ax,90,k}$ (N/mm ²)	4.8	16.96 (*)
	$f_{ax,0,k}$ (N/mm ²)	4.8	14.34 (*)
3.1.4		Characteristic head pull-through parameter	
	$f_{head,k}$ (N/mm ²)	\varnothing [mm]	
		4.8	22.76(*)
3.1.5		Characteristic tensile capacity	
	$f_{tens,k}$ (kN)	\varnothing [mm]	
		4.8	6.63
3.1.6		Characteristic yield strength	
		\varnothing [mm]	
	R_m (MPa)	4.8	1267.1
	$R_{p0.2}$ (MPa)	4.8	1258.8
3.1.7	Characteristic torsional ratio (Characteristic torsional strength/Characteristic torsional resistance into timber)		
3.1.8		\varnothing [mm]	
	$f_{tor,k} / R_{tor,k}$ (Nm) / (Nm)	4.8	5.07/1.94=2.62
3.1.9		Bending angle	
	$Bending\ angle$ (°)	\varnothing [mm]	
		4.8	46°

* density of timber 350 kg/m³

Annex 3 Reference documents

- [1] European Assessment Document EAD 130118-01-0603 Screws and threaded rods for use in timber constructions (edition March 2019)